






DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-59-55

RADIONUCLIDES

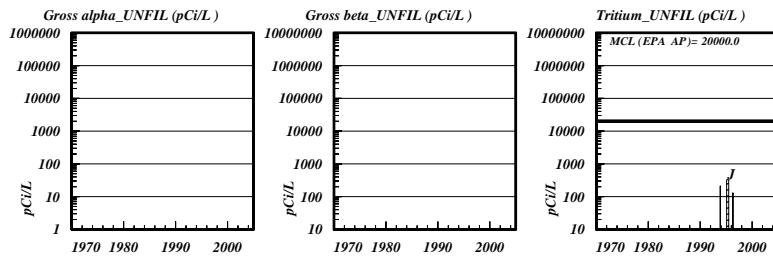



VOLATILE ORGANIC COMPOUNDS

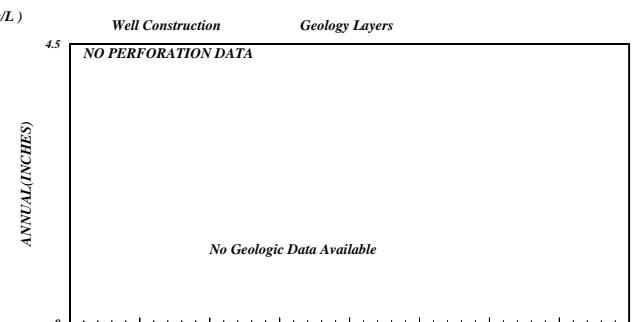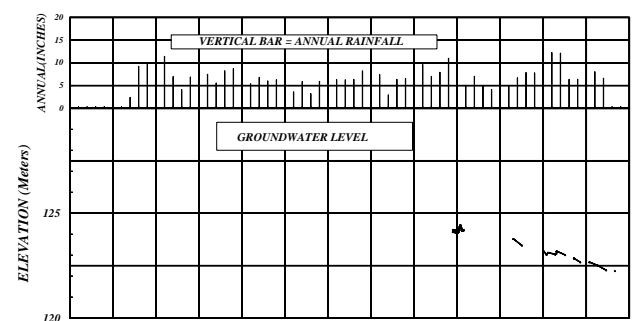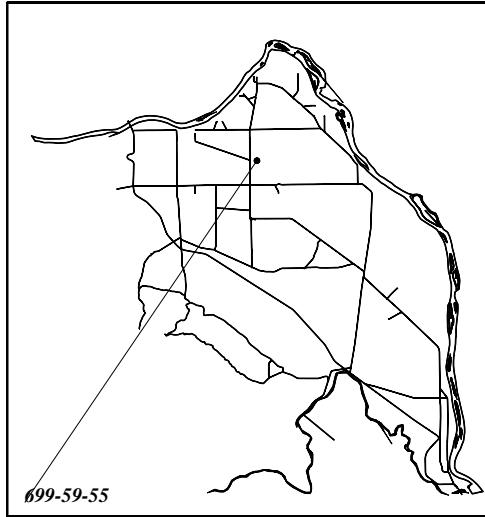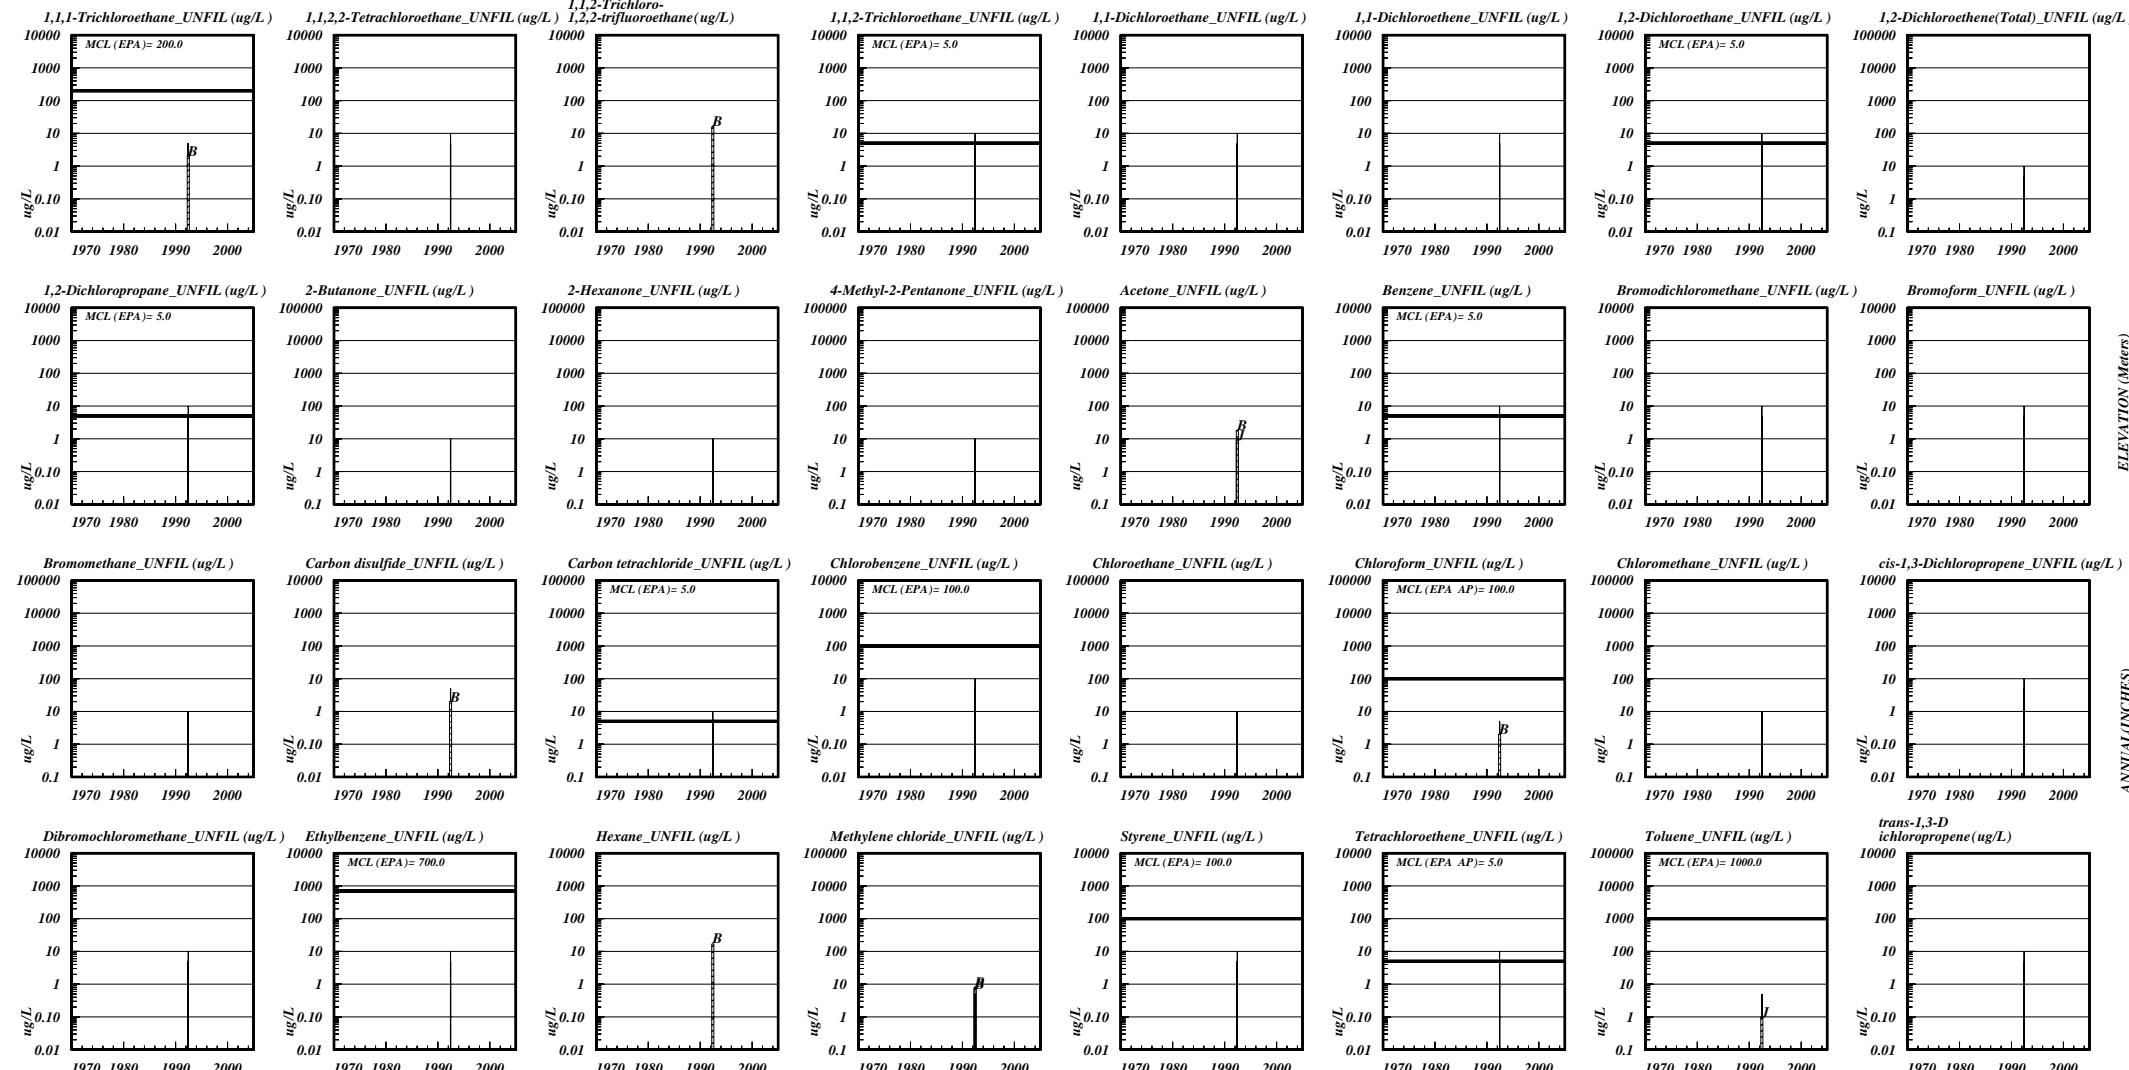

WELLNAME=699-59-55 WELLID=A8918
Well Type=STANDARD Well purpose=BWIP
Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT
Well Construction Date=10/4/1994
X_coor= 573049.30 Y_coor= 141544.10 Datum=NAD83(91) Date Survey= 4/24/1995
Elevation= -131.000 Datum=NGVD29 Date Survey=04/24/95
Ref Point Desc=GROUND SHOT Ref Point side=N Contractor=USACE(JECA)
Well Comment= WAS DH-10 STATUS=IN-USE



LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

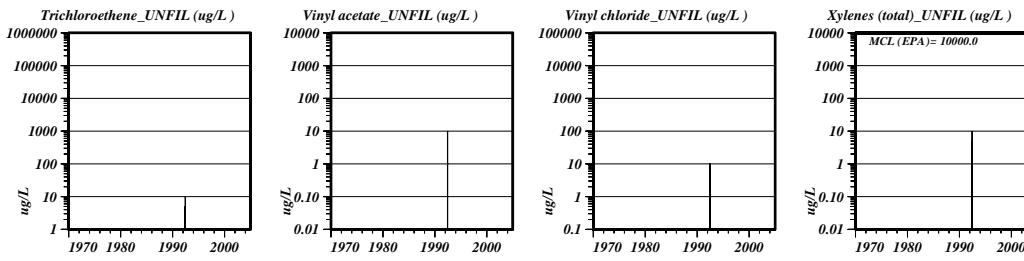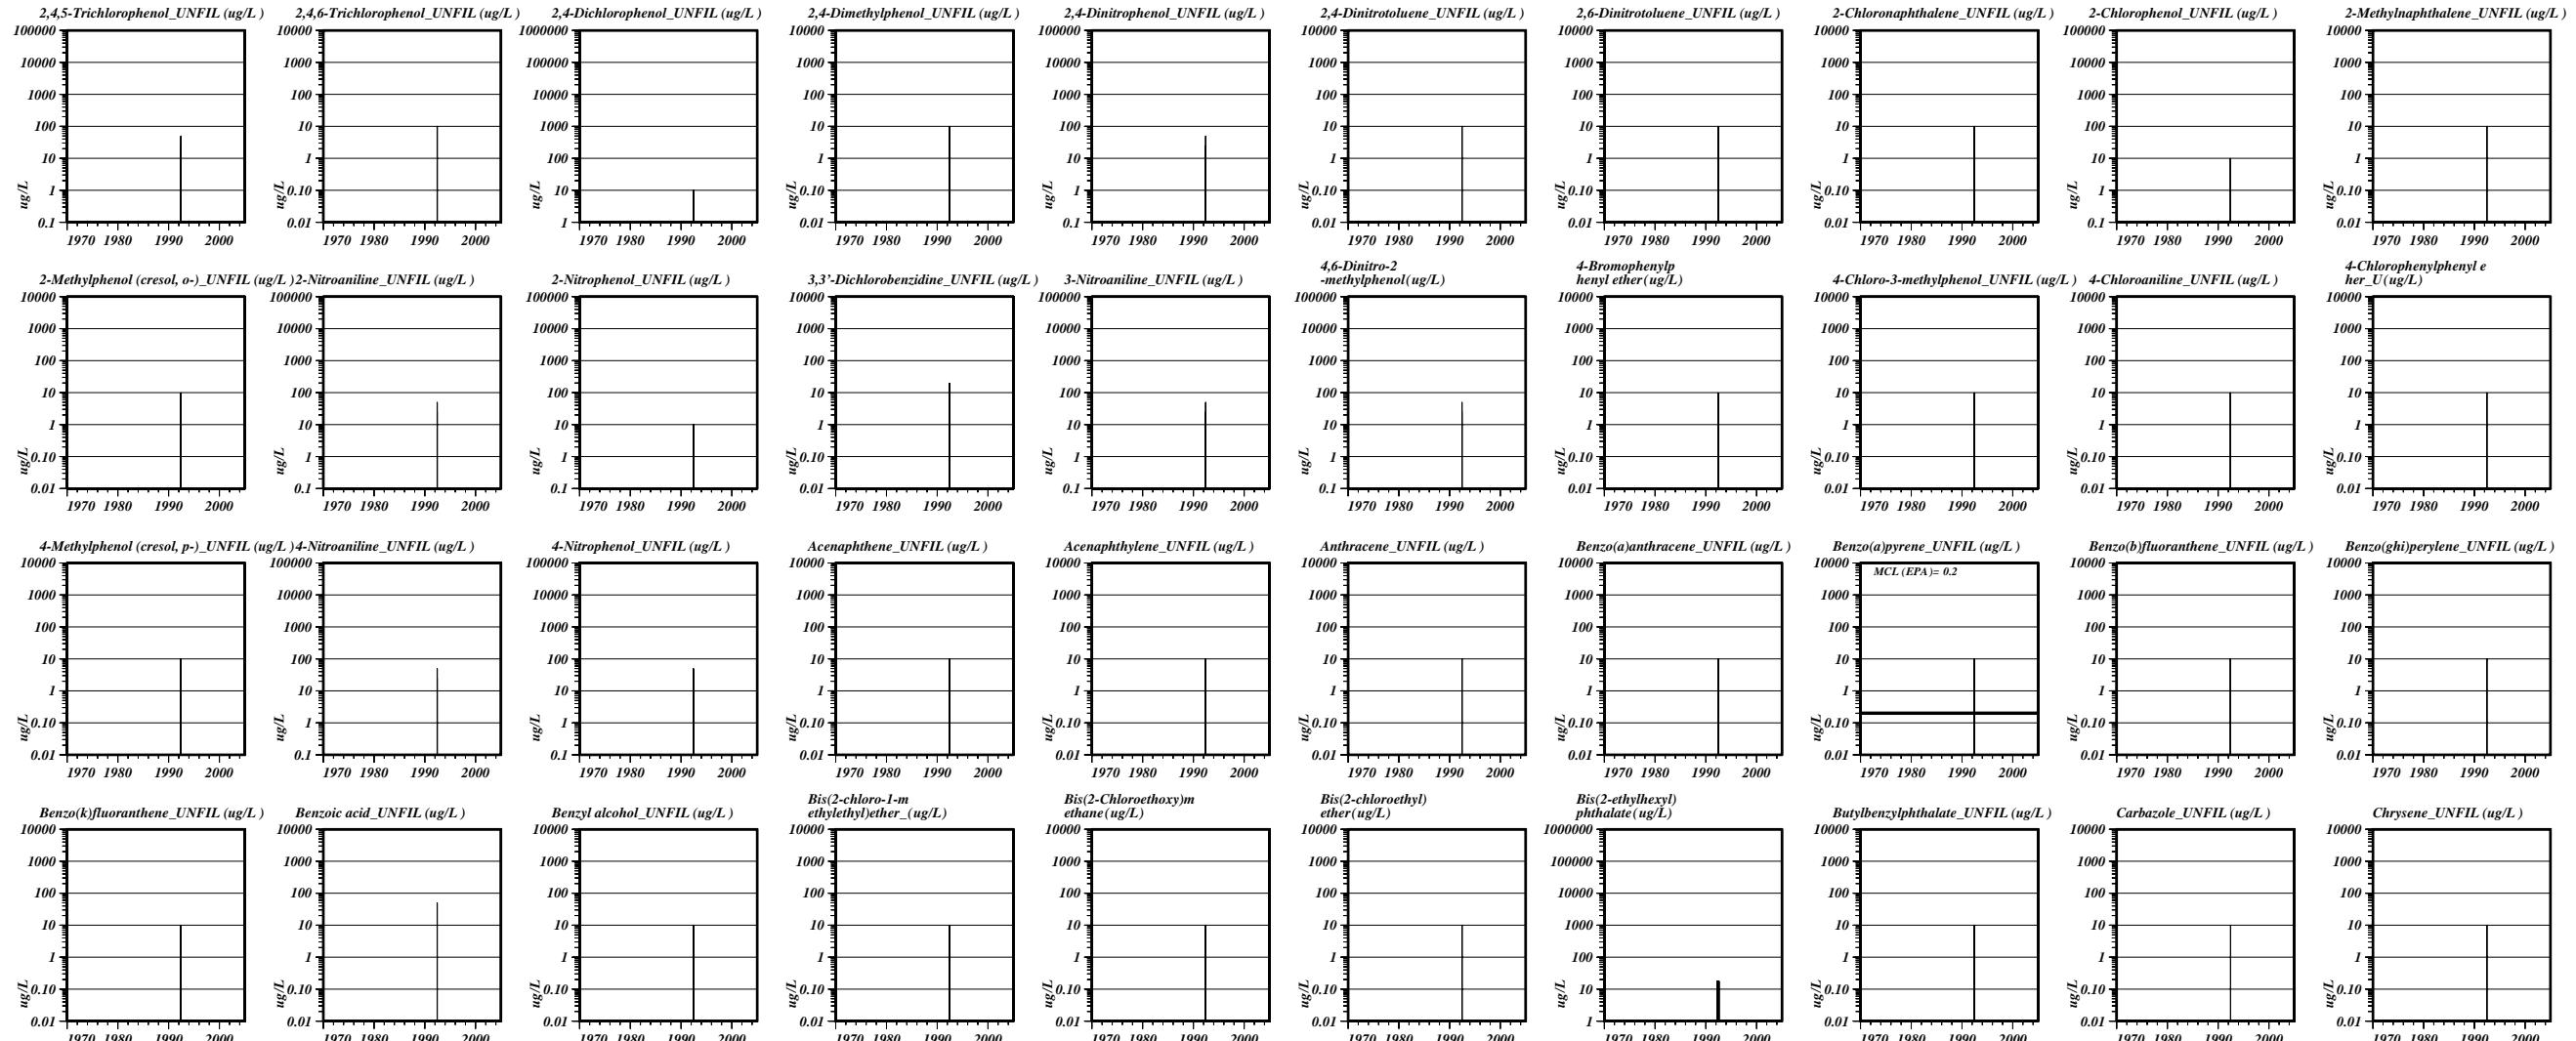VOLATILE ORGANIC COMPOUNDS**SEMI-VOLATILE ORGANIC COMPOUNDS**

LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

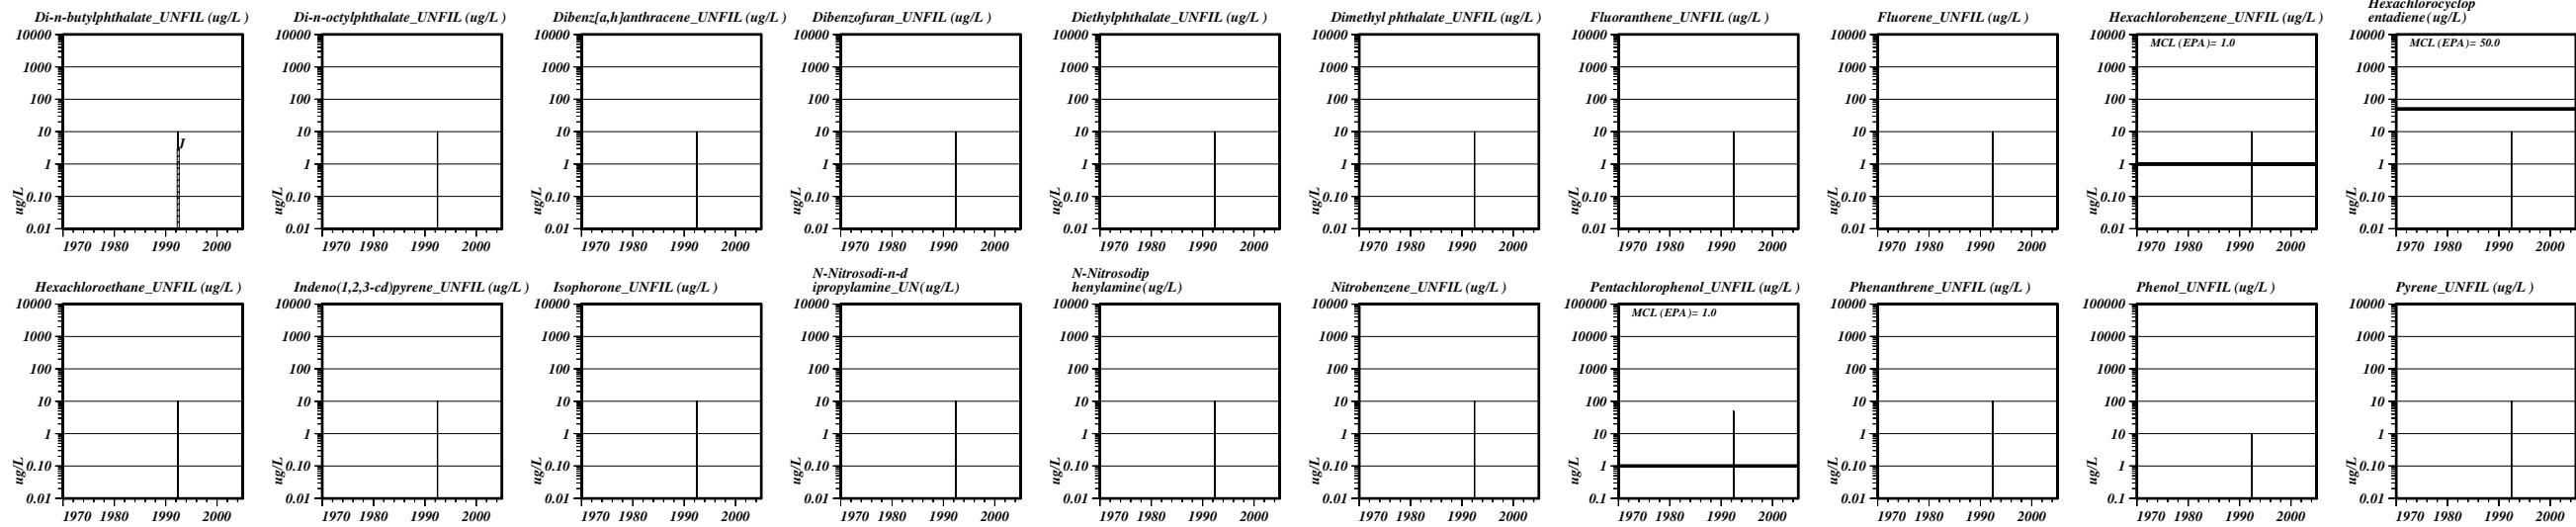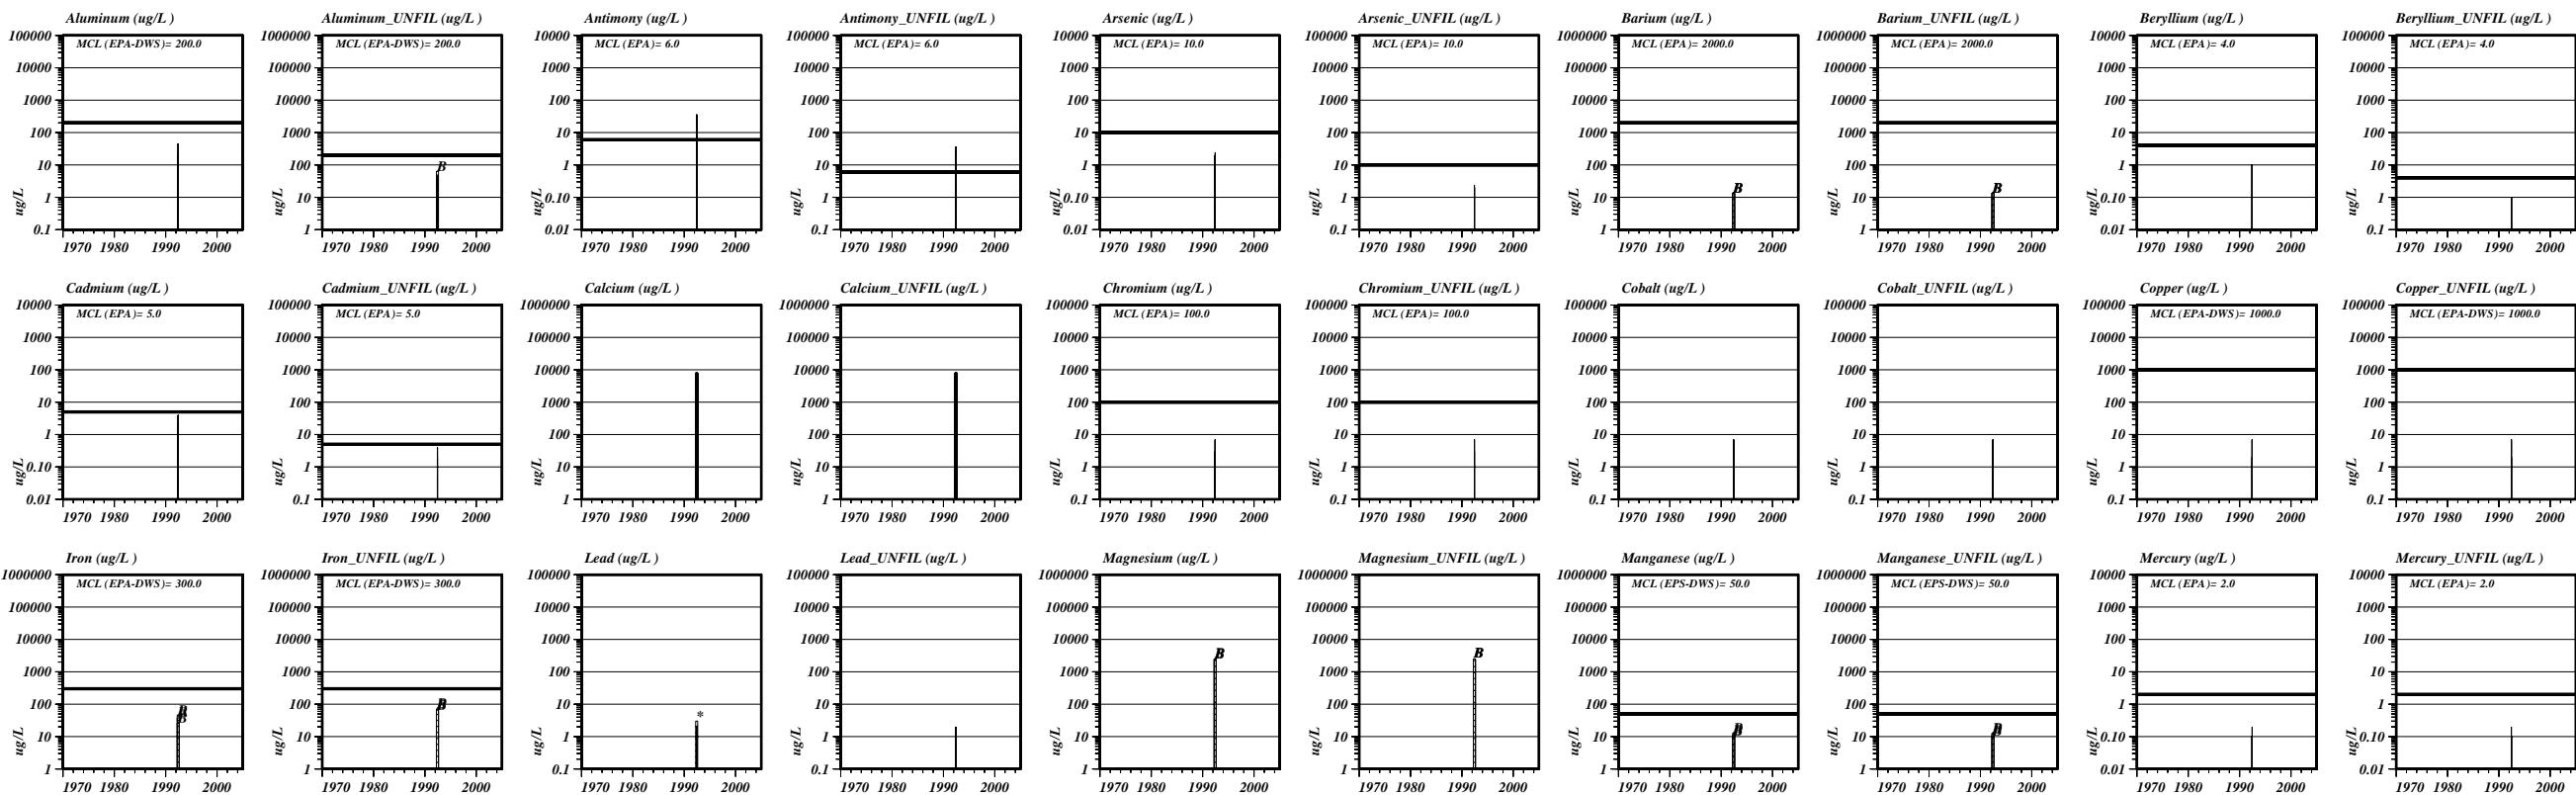SEMI-VOLATILE ORGANIC COMPOUNDS**METALS & PHYSICAL PARAMETERS**


LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-59-55

METALS & PHYSICAL PARAMETERS

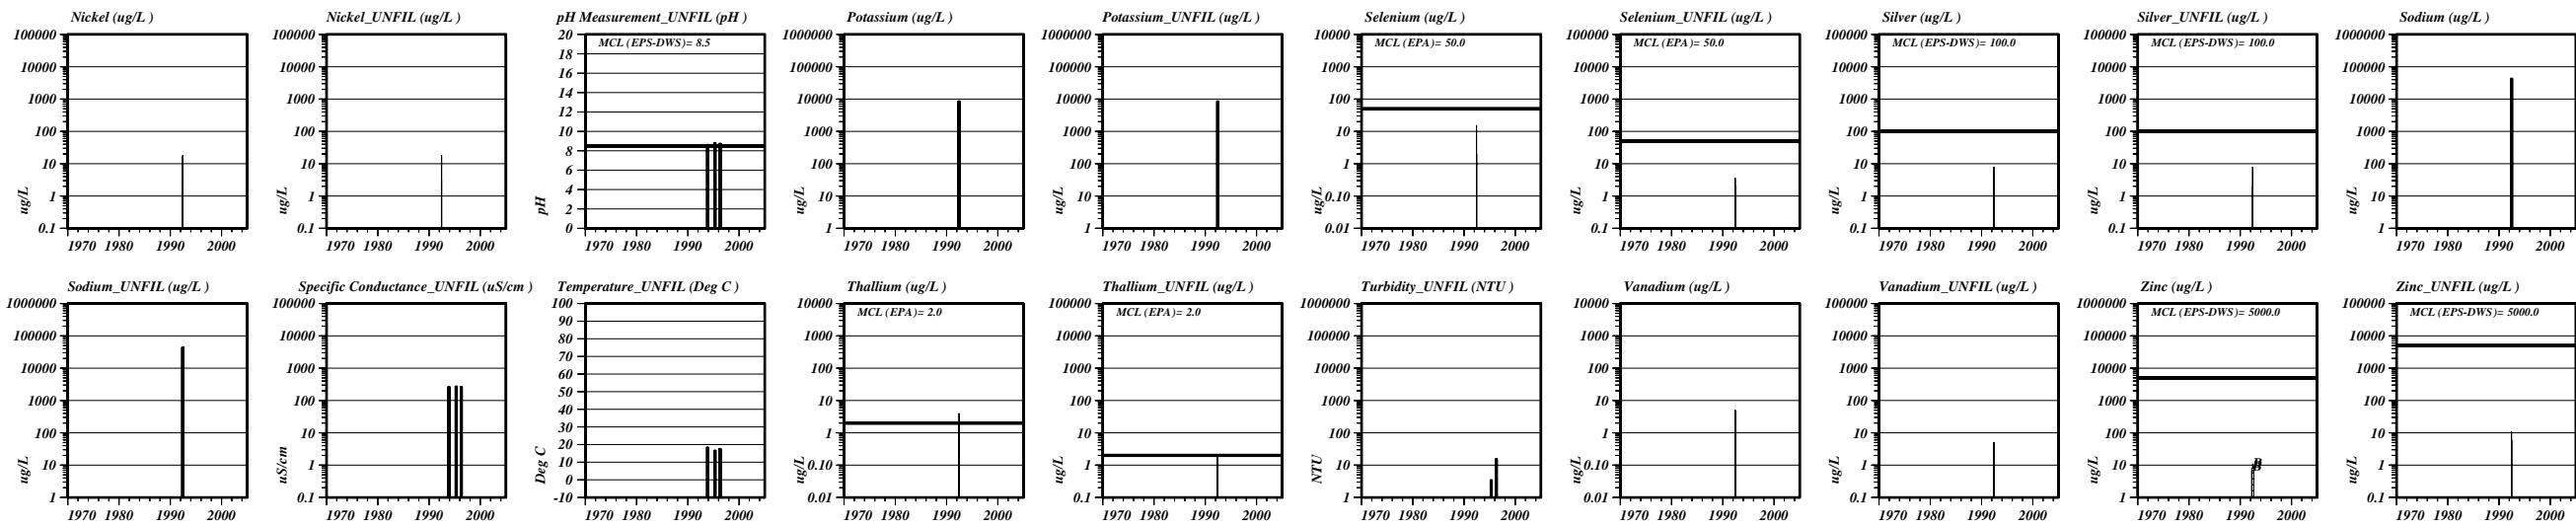


PEST/PCB, HERB, & DIOXINS

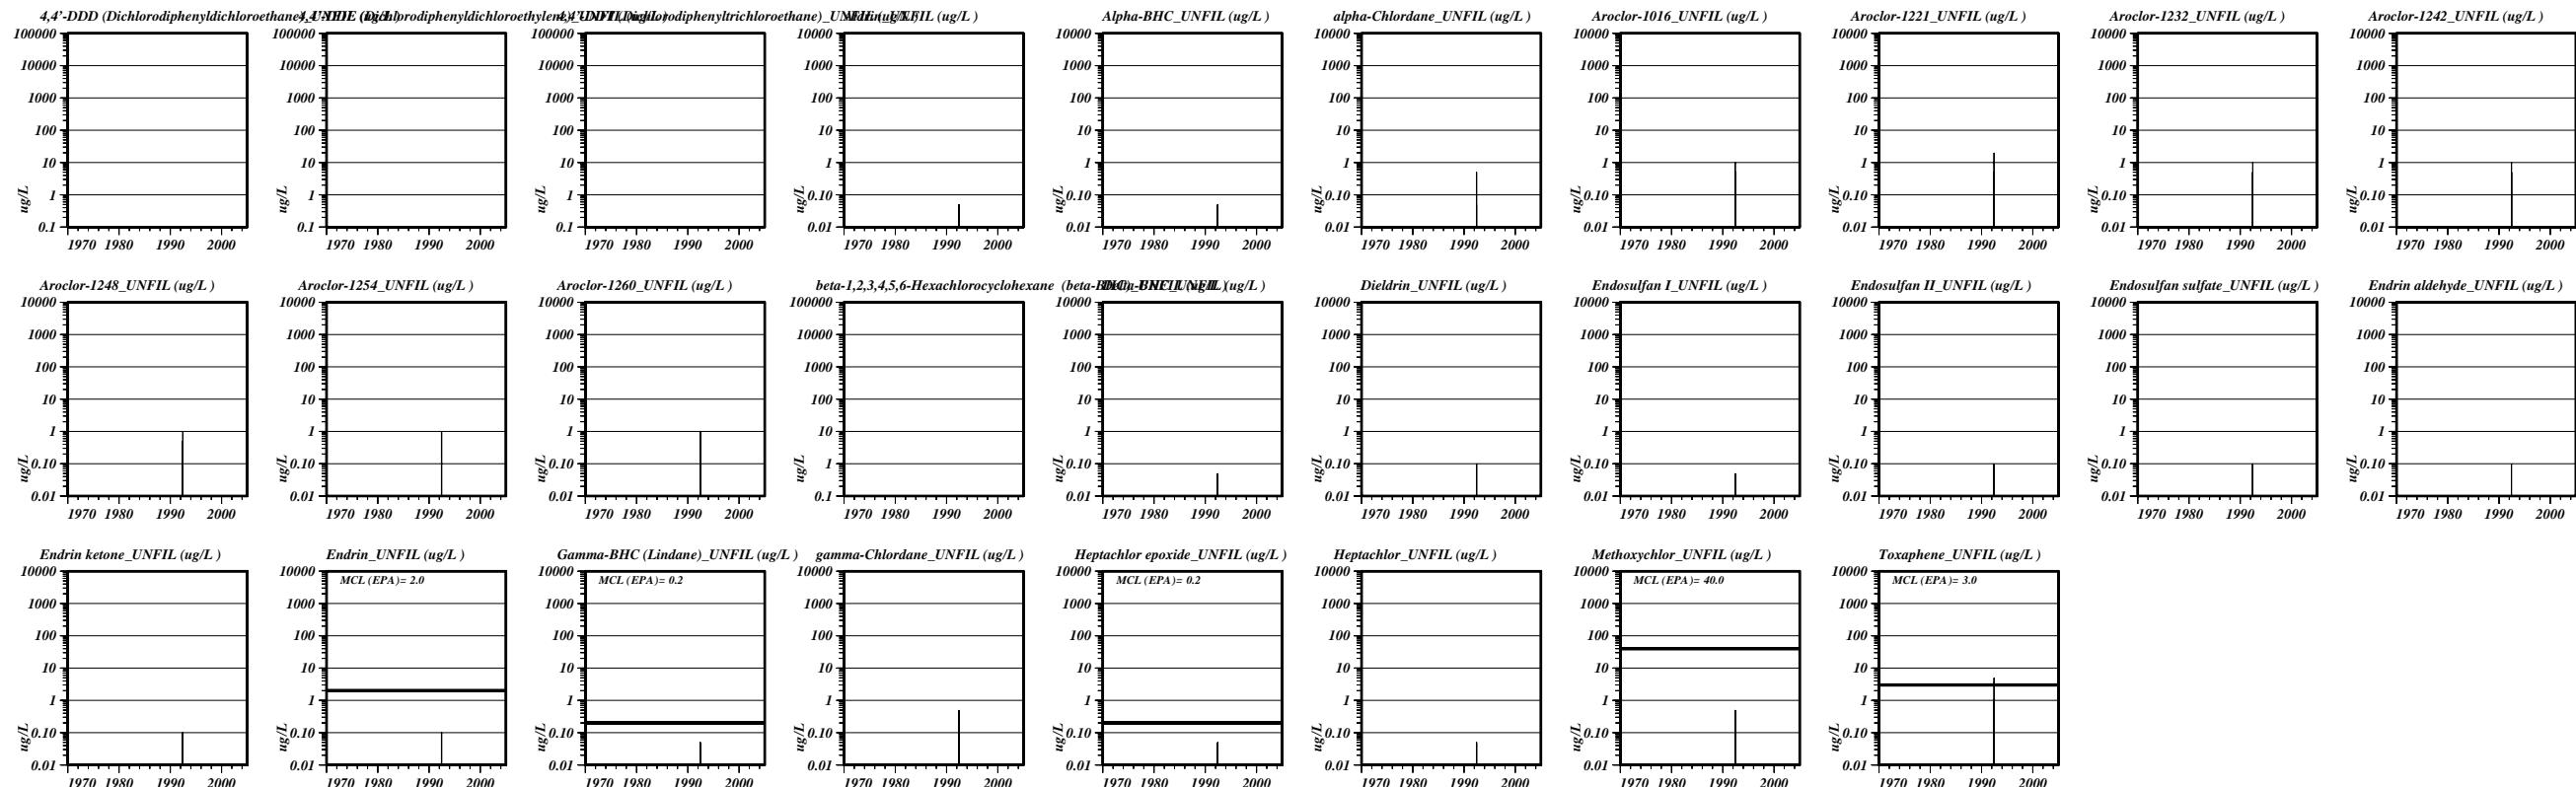

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

GENCHEM & ORGANICS & GENORGANICS

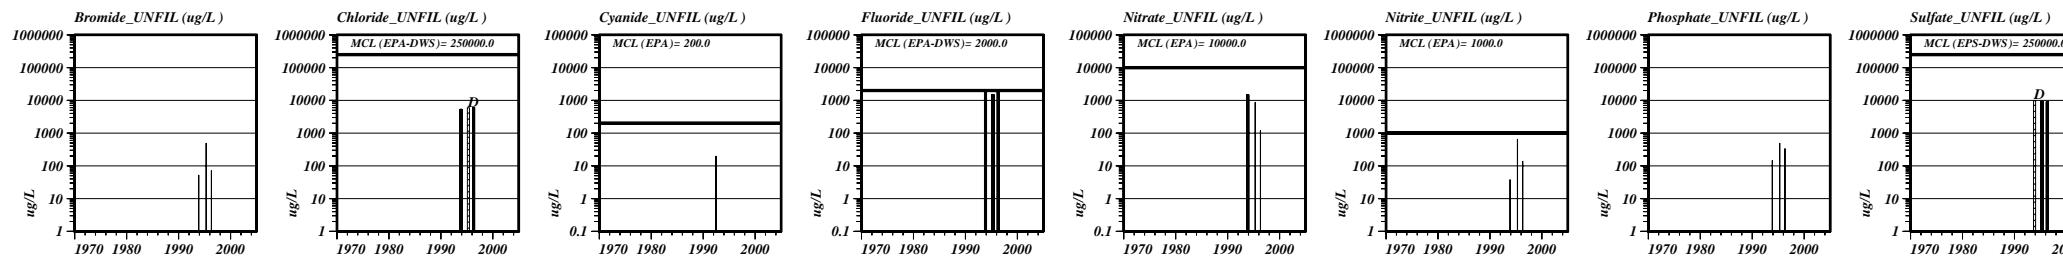

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag